



OPC Server 与 influxDB 通讯配置

北京东方鼎晨科技有限公司

2022 年 12 月 18 日

目录

1. OPC Server 与 influxDB 通讯配置	2
1.1. 新建 OPC UA Plug-in	2
1.2. 新建 influxDB Plug-in	3
1.3. 新建 Data sources and destinations	4
1.4. 新建 Connections.....	4

1. OPC Server 与 influxDB 通讯配置

1.1. 新建 OPC UA Plug-in

OPC UA

Name: test ua

Client certificate: Legacy (unsafe)

Trusted server certificates: All

Endpoint: opc.tcp://Win2012Std:49320

Access Path: ...

Sample rate (ms): 50 Transfer OPC null values

Timeout (ms): 15000

Array write mode: Use raw array

Item identification: Node ID

Anonymous Log-on Highest security level

Log-on as

User:

Password:

Security Options

Mode: None

Encryption: None

Redundancy server


Redundancy settings

Redundancy server:


Item (optional):

Check connection OK Cancel

1.2. 新建 influxDB Plug-in

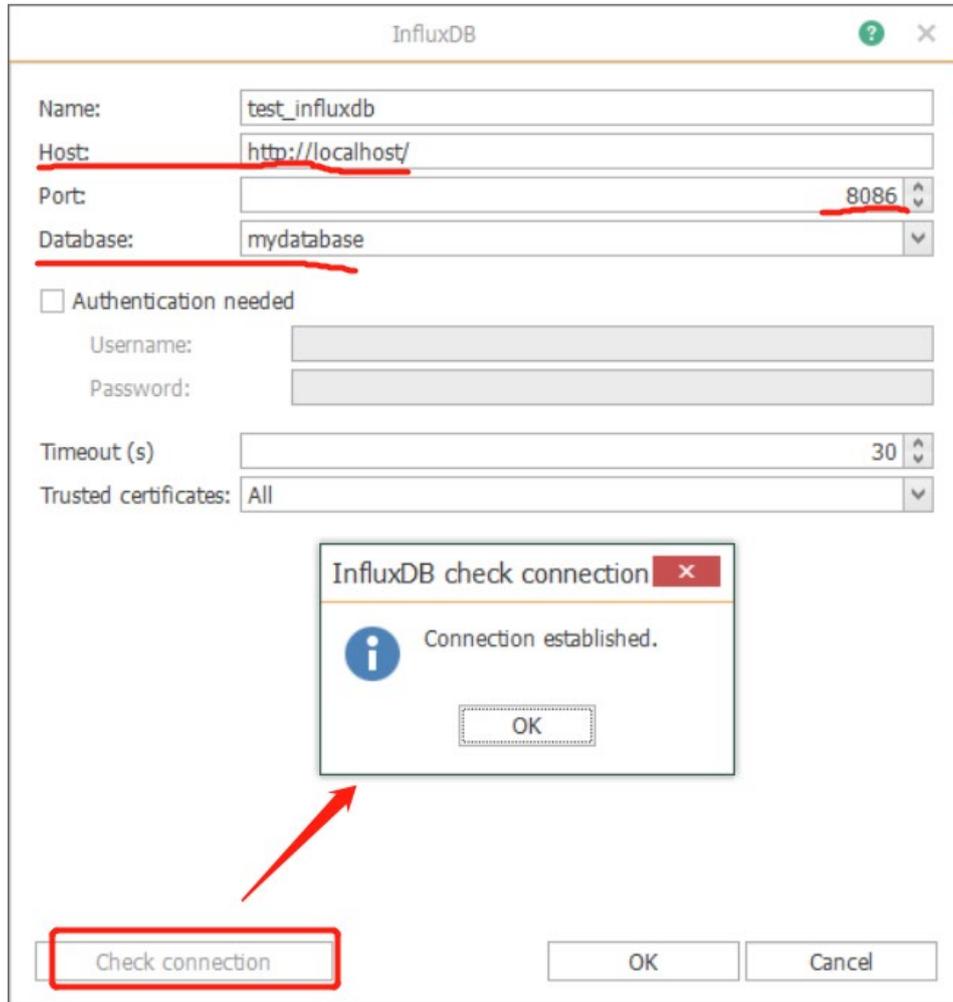


1.3. 新建 Data sources and destinations

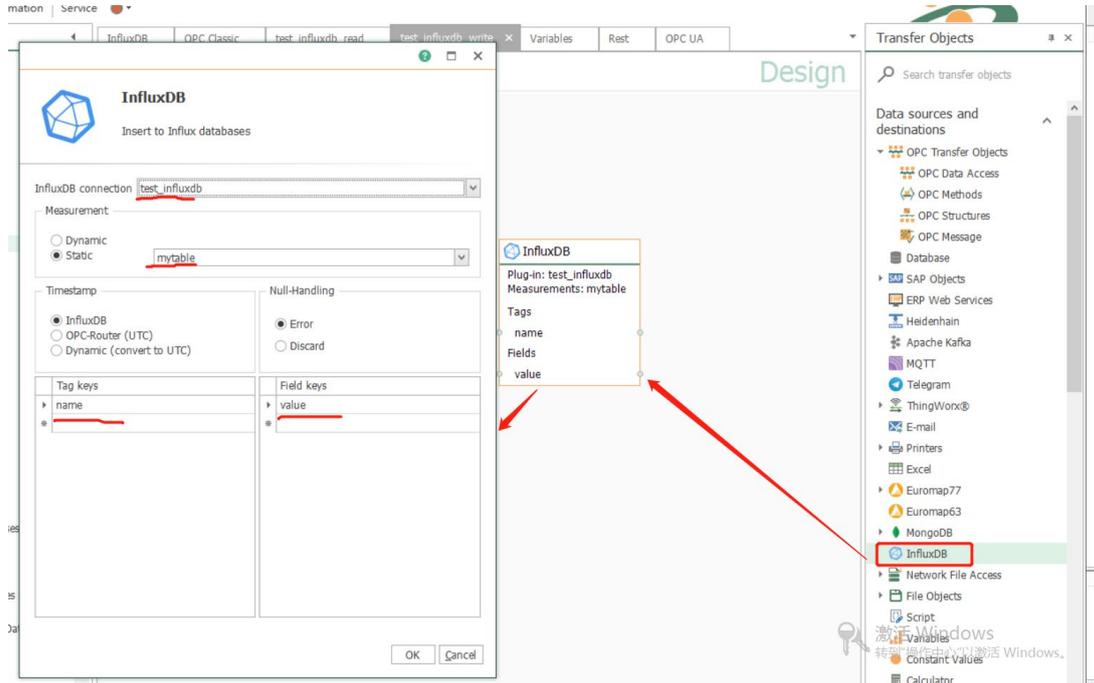

Name , value 是 influxDB 表里的两个字段。

1.4. 新建 Connections

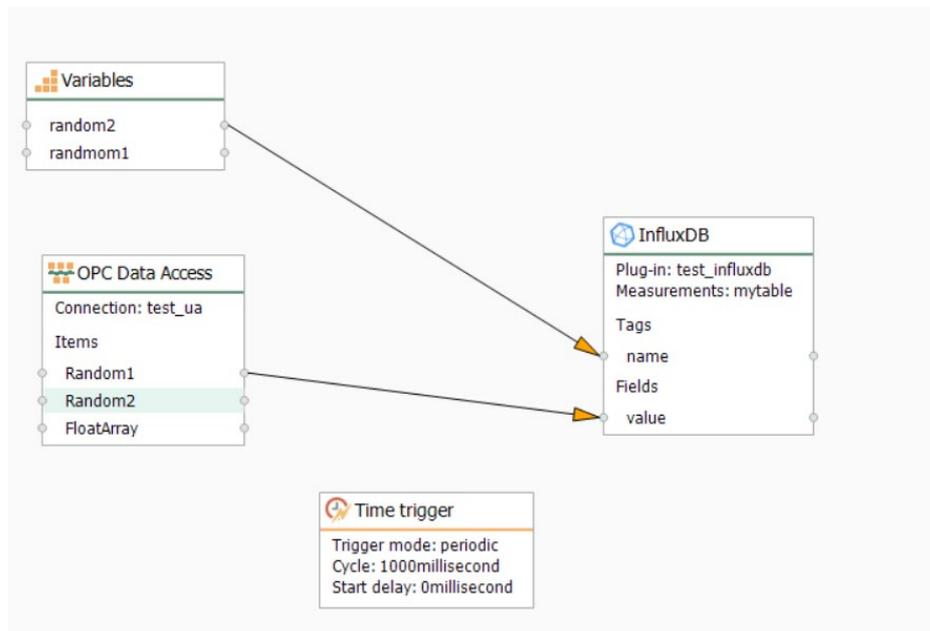

完成 OPC UA Server 数据写入 influxDB。